

Wall Ventilation Hood

DA 5196 W



Wall Ventilation Hood DA 5196 W



FEATURES


- NEW: LED ClearView lighting
- NEW: Con@ctivity — communication between hood and cooktop
- Four fan speeds (incl. intensive)
- Delayed shutdown for 5 or 15 minutes
- Programmable filter saturation timers
- Stainless steel finish
- Polished steel logo
- Automatic shutdown of intensive level, programmable for 10 minutes

SPECIFICATIONS

DA 5196 W — Item 28519650USA

Vented or Recirculating	625 CFM setting
Canopy Dimensions	35 ¹ / ₄ " (895mm) W x 3 ⁹ / ₁₆ " (91mm) H x 20 ¹ / ₂ " (520mm) D
Dimensions (Standard Height) - Vented	28 ⁵ / ₁₆ " — 40 ³ / ₁₆ " (720—1020mm) H
Dimensions (Standard Height) - Recirculating	33 ¹ / ₂ " — 44 ⁷ / ₈ " (850—1140mm) H
Chimney Dimensions	11 ³ / ₈ " (290mm) W x 10 ⁵ / ₈ " (270mm) D
Minimum distance above cooktop	Please refer to page 26 of the installation manual
Color	Available in brushed stainless steel or RAL colors
Electrical	
Electrical Requirements	120 V, 60 Hz, 15 Amps
Power Cord	Molded plug 2.5 ft (0.75m) NEMA 5-15
Electrical Rating	362 W (Blower: 350 W; Lighting: 4x3 W)
Optional Accessories	
Recirculating Kit	DUW 20 Recirculating Kit
OdorFree Charcoal Filter	DKF 12-1 OdorFree Charcoal Filter
Reducing Collar (air flow max. 400 CFM)	
Shipping	
Shipping Weight	57.2 lbs (26kg)
Support	
Call	800.843.7231
20/20	2020technologies.com

PRODUCT VIEW

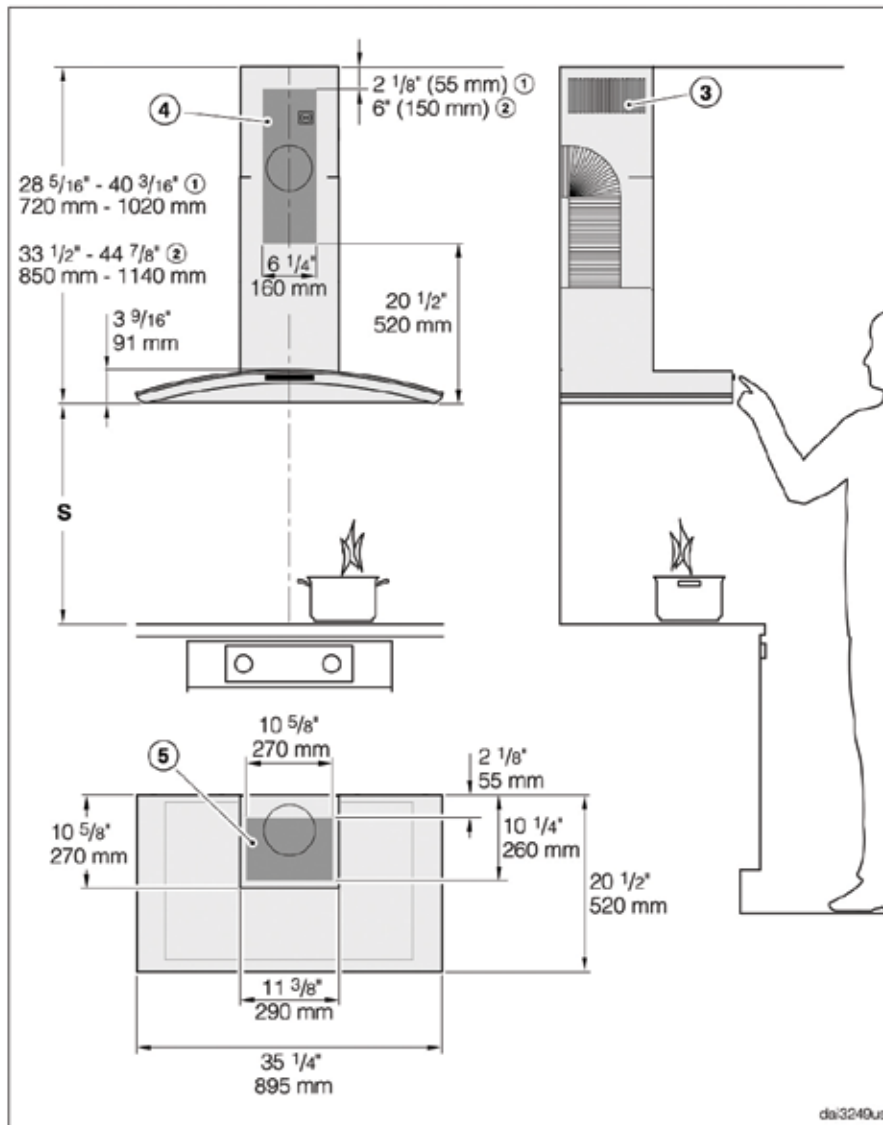

The drawing is not to scale.

- ① Extraction
- ② Recirculation
- ③ Air vent positioned at top for recirculation
- ④⑤ Mounting area (only ④ is required for recirculation ventilation hoods). Wall and ceiling area for exhaust duct opening and for wall socket installation. Only the wall socket installation is required for recirculation hoods.

Vent collar \varnothing 6" (150 mm), with adapter \varnothing 5" (125 mm).

PLEASE NOTE: The majority of the weight of the installed ventilation system will be supported by the lower retaining plate. It must be firmly attached to the stud framing behind the drywall. If studs are not available in the required locations, a plywood backing (min. 1/2" (13 mm) thick) spanning at least two studs must be installed. Failure to adequately support the weight as stated may result in the ventilation system falling off the wall, causing personal injury and property damage.